
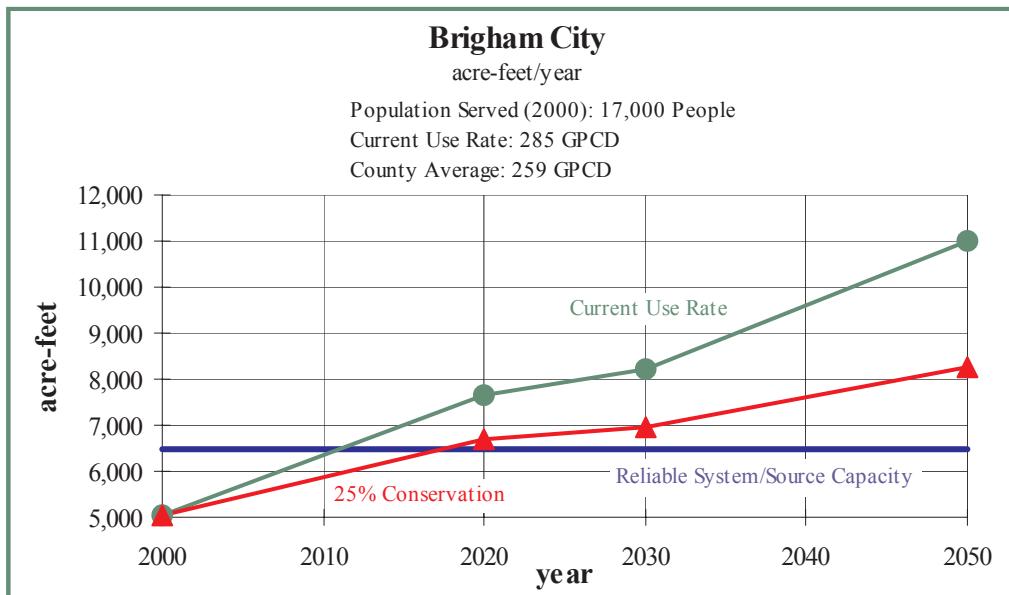


Water Supply vs. Demand Graphs

The following Water Supply vs Demand Graphs are presented alphabetically by county.

These graphs show the inter-relationships between each town's existing system's reliable system/source capacity and its projected demand for the next fifty years. Each figure includes a pair of future demand lines. The green line shows the community's projected water needs based upon its current use rate, while the Red line shows the reduction in demand if twenty-five percent conservation is achieved by the year 2050. The system's existing reliable system/source capacity is shown in blue. Also shown on each figure is the population served in 2000, the current use rate in gallons per capita day, and for comparison the county average per capita use rate


Box Elder County Communities:

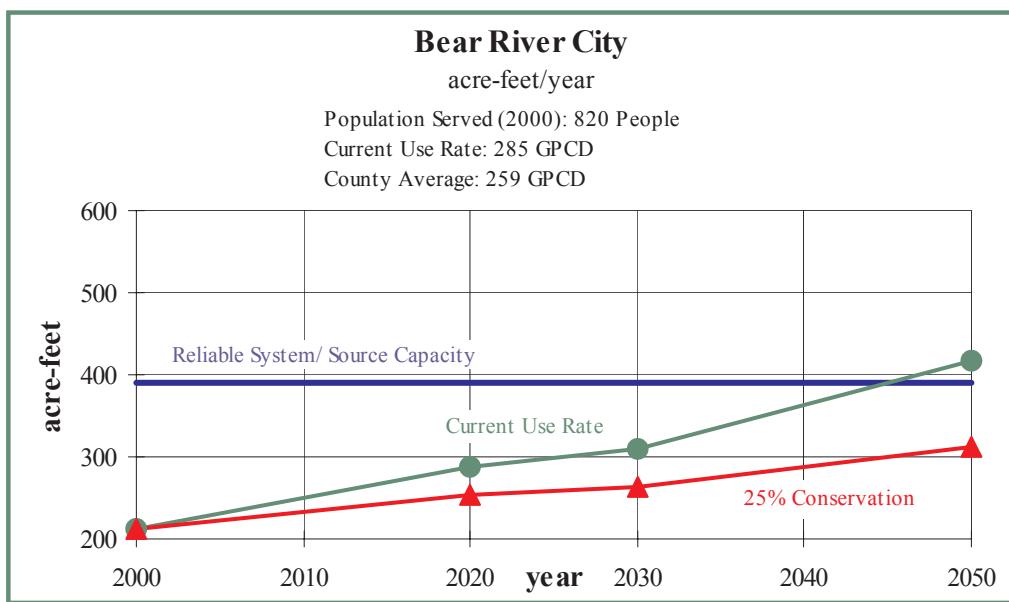

Corinne City Corp

acre-feet/year


Population Served (2000): 646 People
Current Use Rate: 253 GPCD
County Use Rate: 259 GPCD

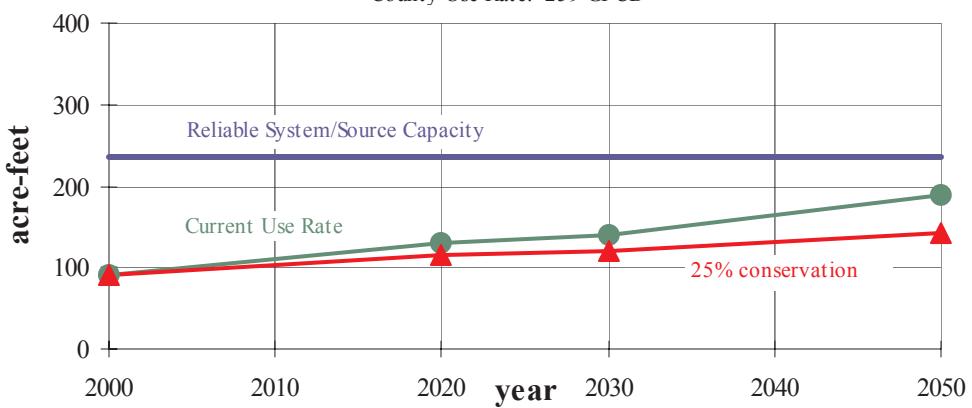

Deweyville Municipal Water System

acre-feet/year


Population Served (2000): 350 People
Current Use Rate: 329 GPCD
County Average: 259 GPCD

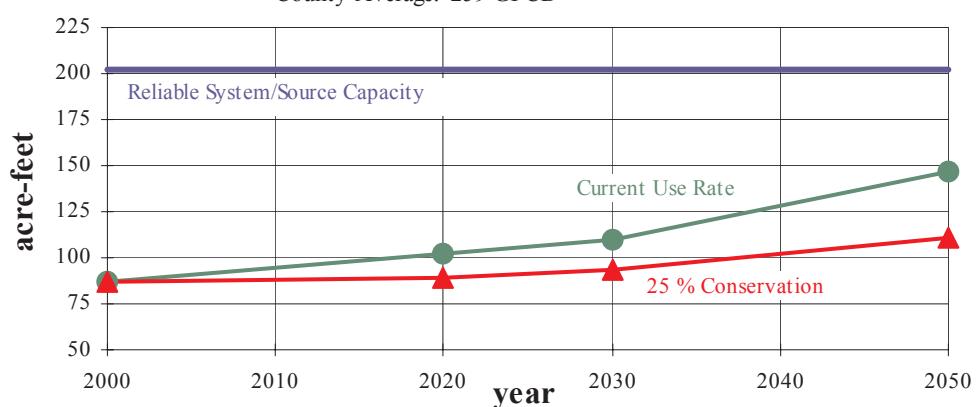

Elwood Town

acre-feet/year

Population Served: 625 People
Current Use Rate: 291 GPCD
County Average: 259 GPCD

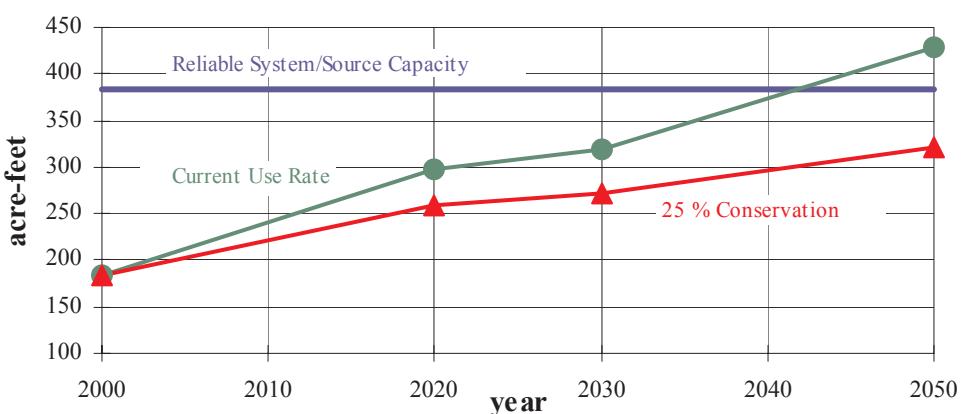


Garland City

acre-feet/year

Population Served (2000): 1,680 People

Current Use Rate: 251 GPCD

County Average: 259 GPCD

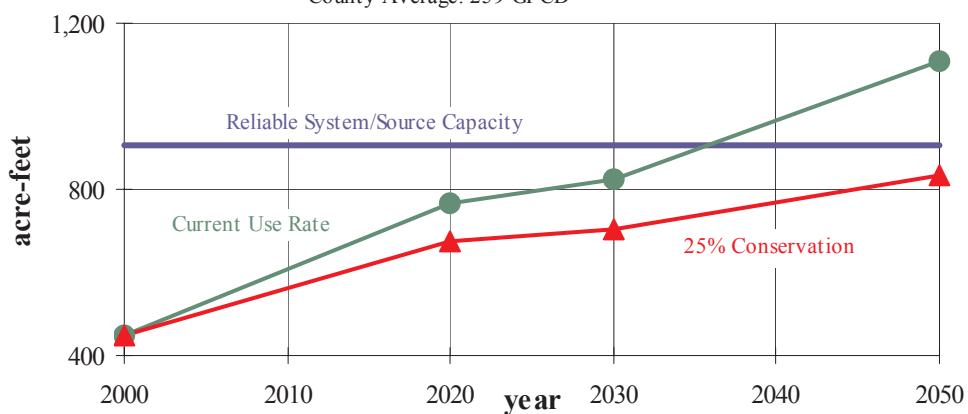


Honeyville Municipal Water System

acre-feet/year

Population Served: 1,250 People

Current Use Rate: 380 GPCD

County Use Rate: 259 GPCD

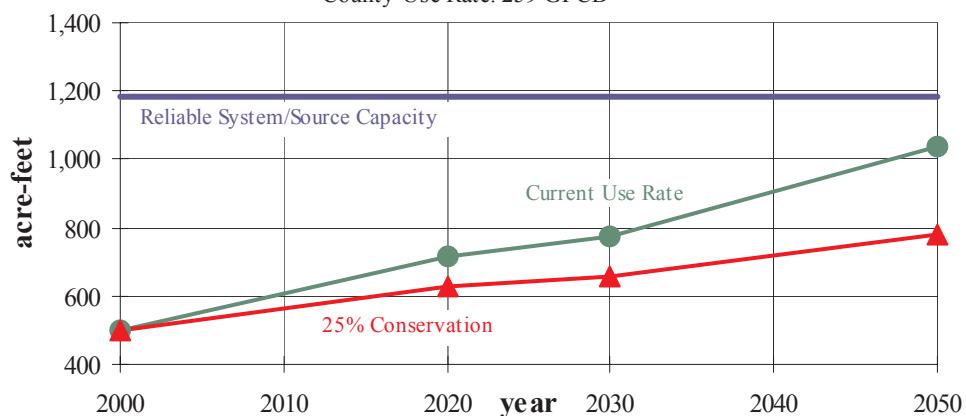


Mantua Culinary Water System

acre-feet/year

Population Served (2000): 708 People

Current Use Rate: 253 GPCD


County Use Rate: 259 GPCD

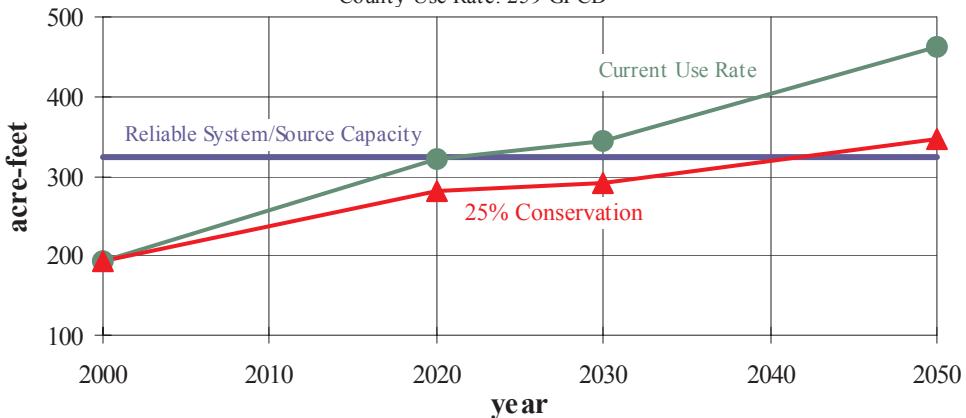

North Garland

acre-feet/year


Population Served (2000): 1,100 People
Current Use Rate: 283 GPCD
County Use Rate: 259 GPCD

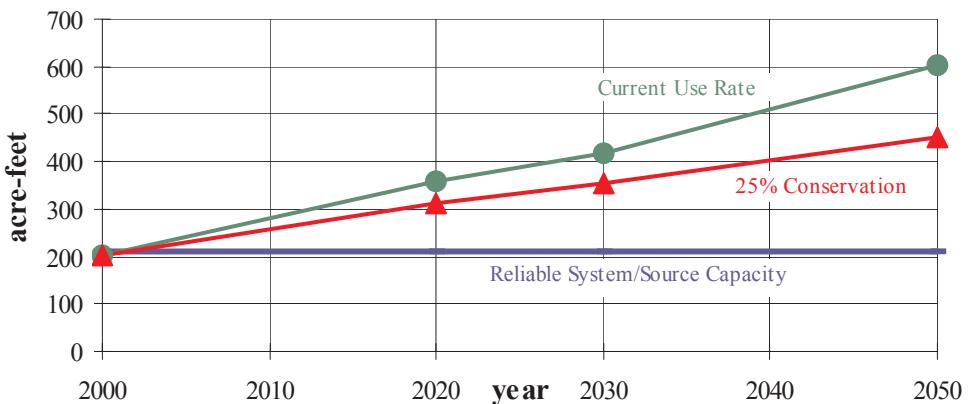

Perry City Water System

acre-feet/year


Population Served (2000): 2,000 People
Current Use Rate: 273 GPCD
County Use Rate: 259 GPCD

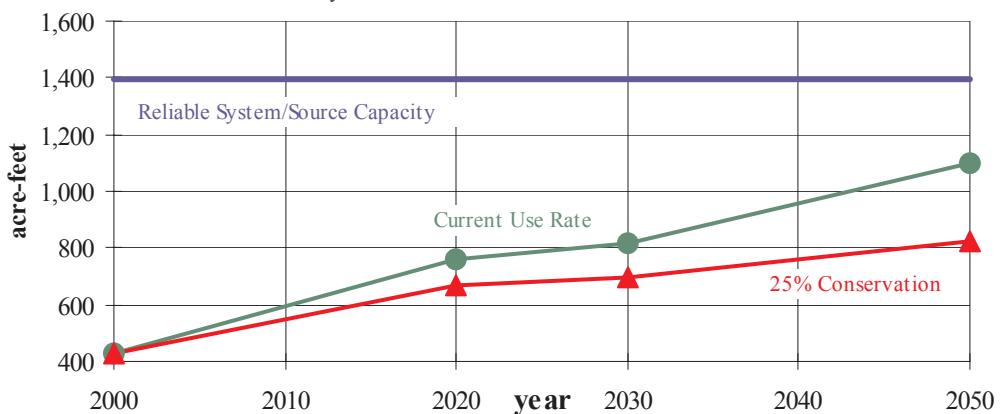

Plymouth - Water Supply vs Demand

acre-feet/year

Population Served (2000): 4000 People
Current Use Rate: 223 GPCD
County Use Rate: 259 GPCD

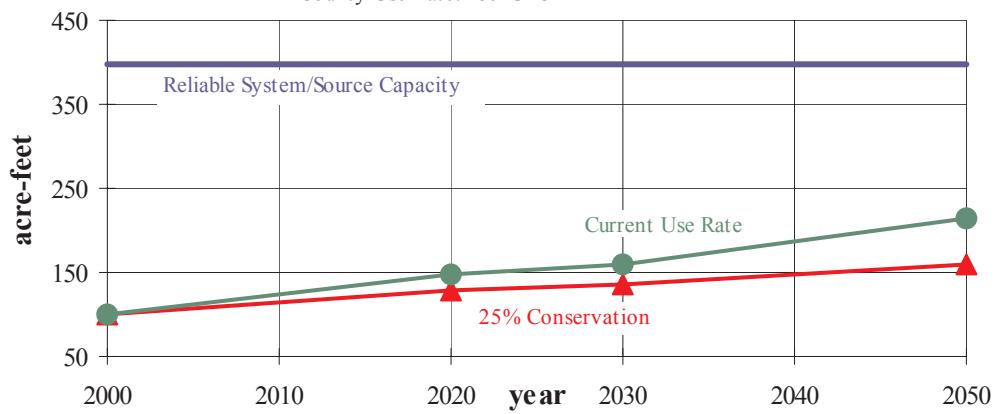


Portage Municipal Water System

acre-feet/year

Population Served (2000): 250 People

Current Use Rate: 287 GPCD

County Use Rate: 259 GPCD

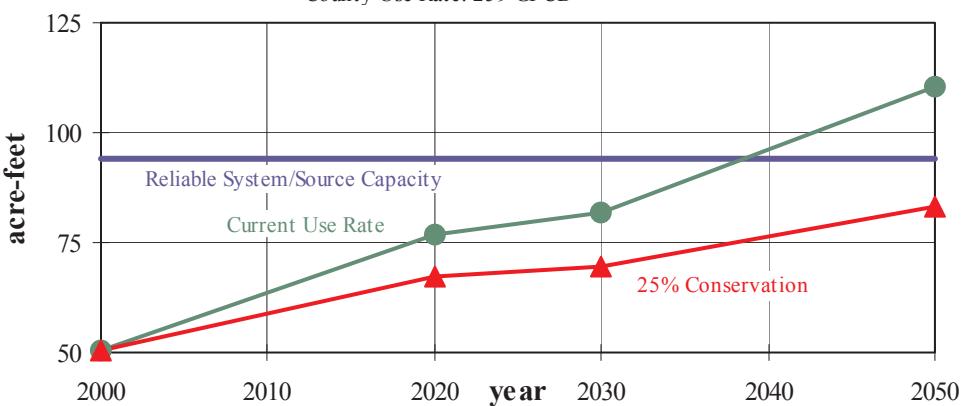


South Willard

acre-feet/year

Population Served (2000): 265 People

Current Use Rate: 263 GPCD

County Average: 259 GPCD

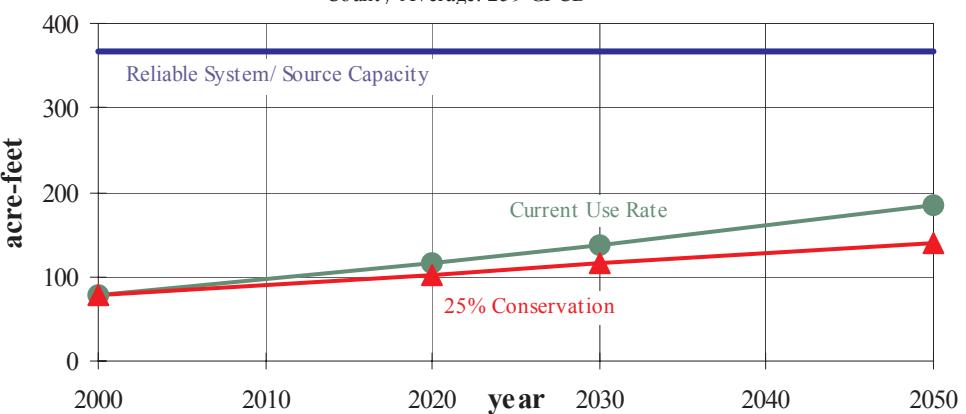


Thatcher-Penrose

acre-feet/year

Population Served (2000): 700 People

Current Use Rate: 253 GPCD

County Average: 259 GPCD

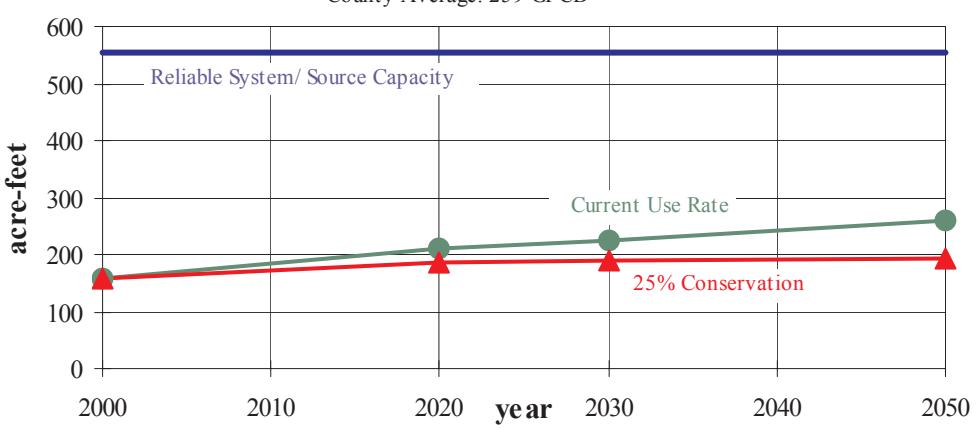


Tremonton

acre-feet/year

Population Served (2000): 5,000 People

Current Use Rate: 259 GPCD

County Use Rate: 259 GPCD

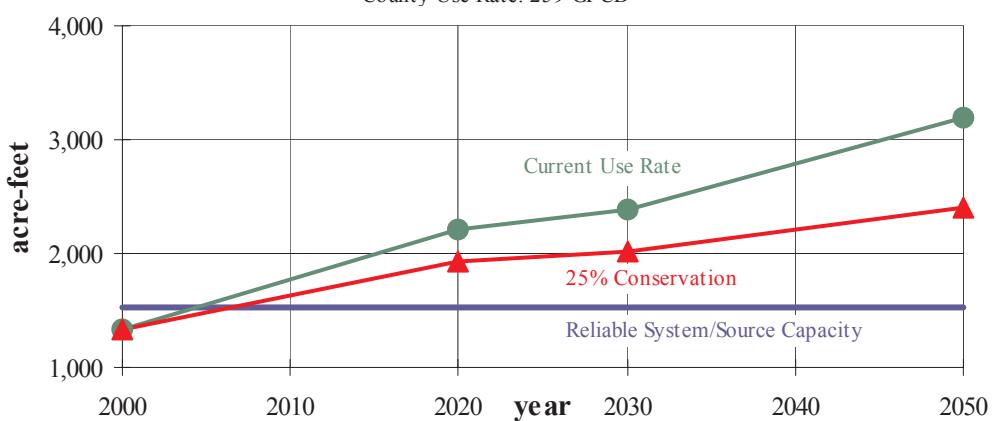


Ukon Water Company

acre-feet/year

Population Served (2000): 920 People

Current Use Rate: 326 GPCD

County Use Rate: 259 GPCD

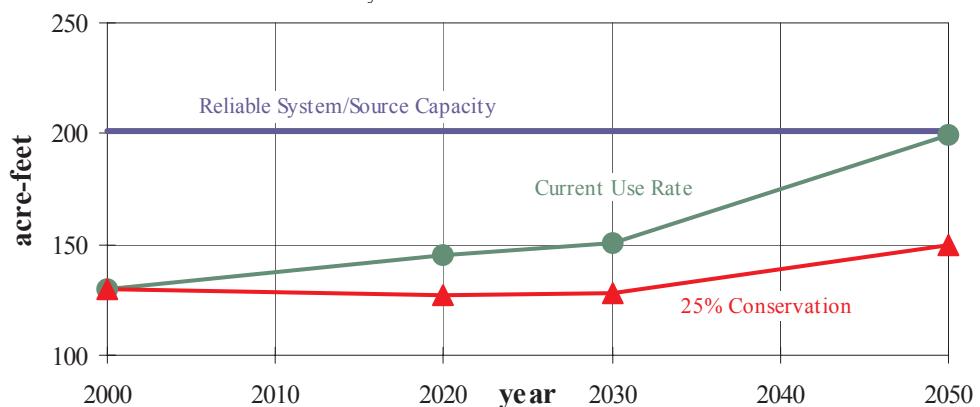


West Corinne Water Company

acre-feet/year

Population Served (2000): 1,345 People

Current Use Rate: 658 GPCD

County Use Rate: 259 GPCD

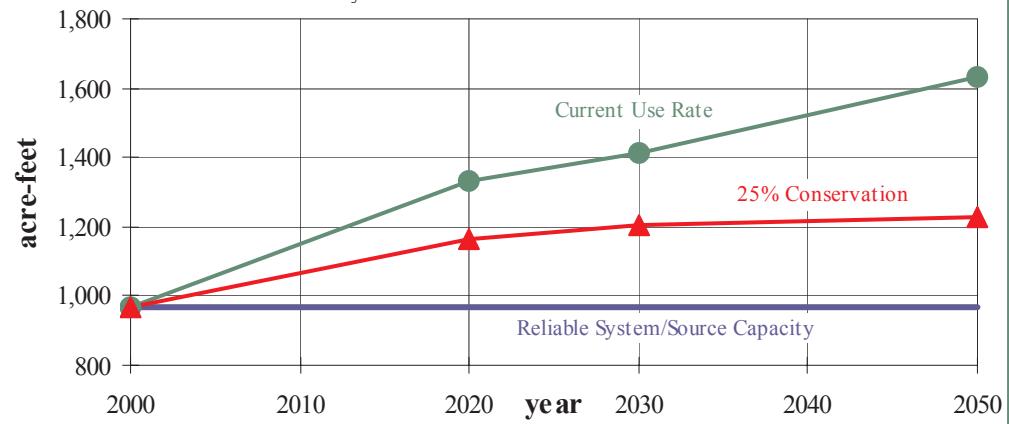


Willard Municipal Water System

acre-feet/year

Population Served (2000): 1,535 People

Current Use Rate: 307 GPCD

County Use Rate: 259 GPCD

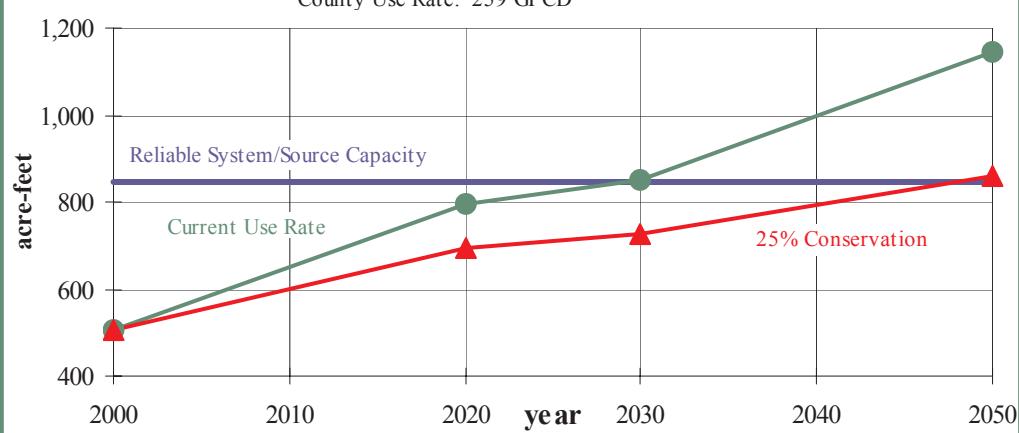

Cache Valley Communities:


Amalga

acre-feet/year

Population Served (2000): 410 People

Current Use Rate: 1,145 GPCD

County Average: 248 GPCD

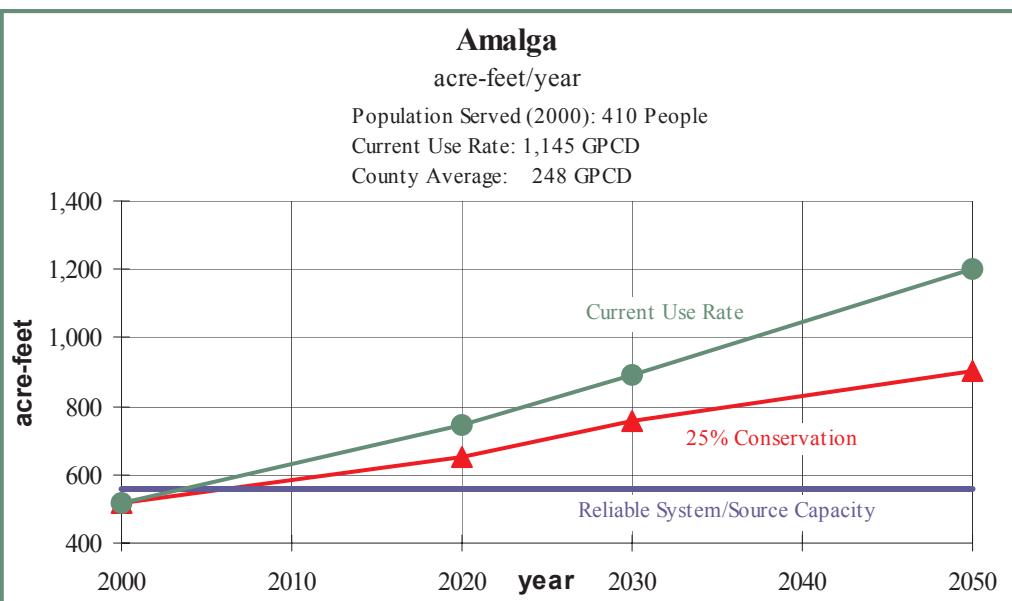


Benson

acre-feet/year

Population Served (2000): 560 People

Current Use Rate: 263 GPCD

County Use Rate: 248 GPCD

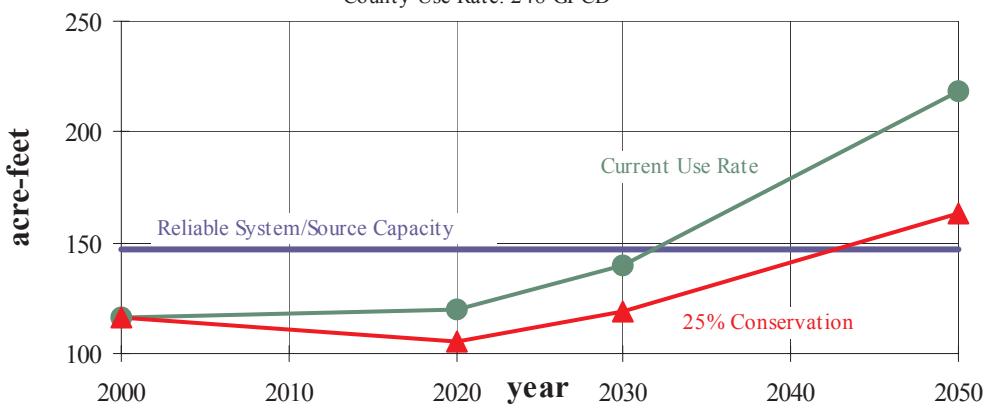


Clarkston Municipal Water System

acre-feet/year

Population Served (2000): 670 People

Current Use Rate: 478 GPCD

County Use Rate: 248 GPCD

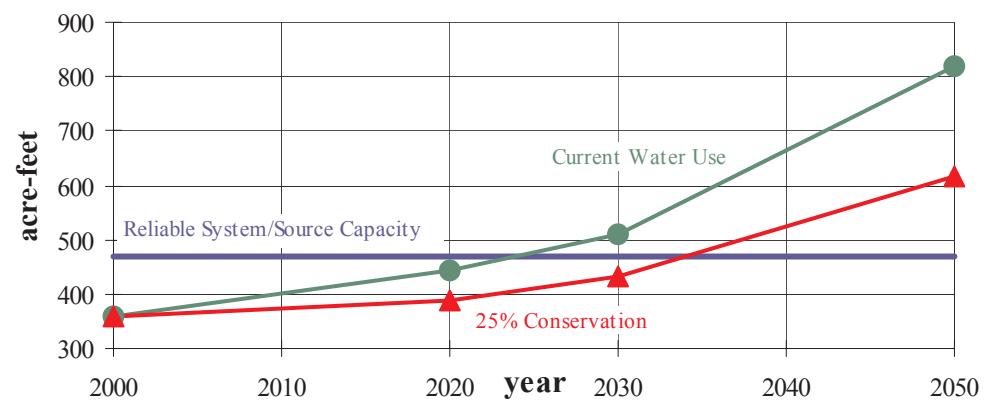


Cornish

acre-feet/year

Population Served (2000): 250 People

Current Use Rate: 369 GPCD

County Use Rate: 248 GPCD

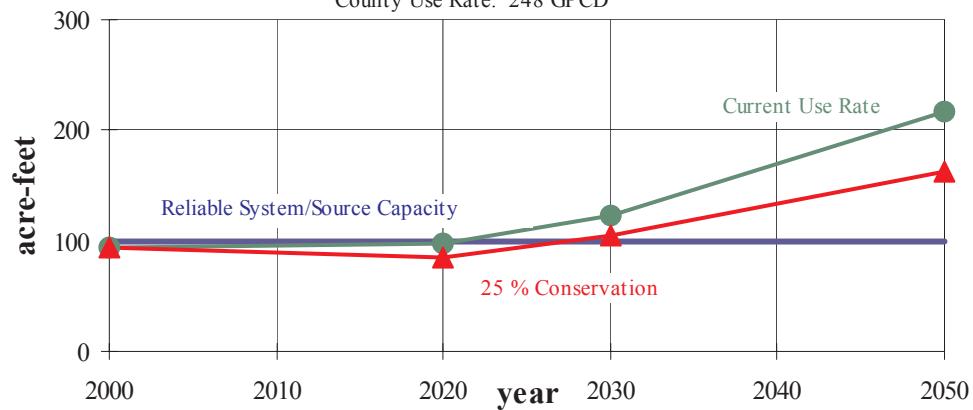


Hyde Park Culinary Water System

acre-feet/year

Population Served (2000): 3,000 People

Current Use Rate: 190 GPCD

County Average: 248 GPCD

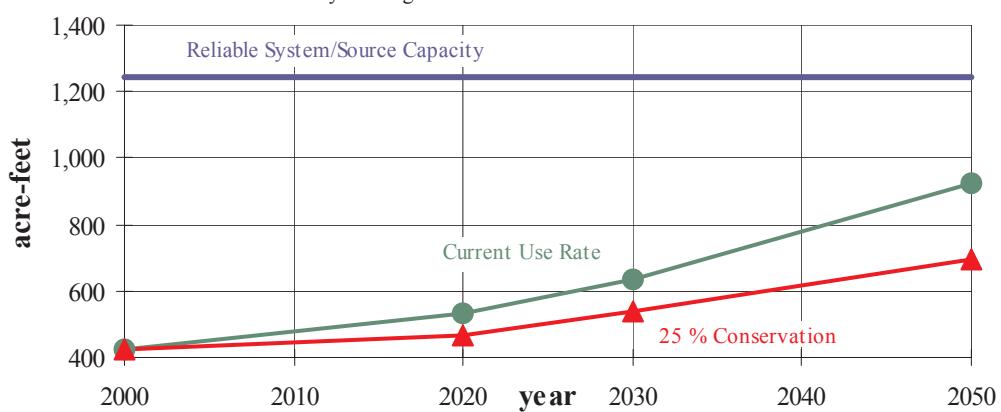


Hyrum City Water System

acre-feet/year

Population Served (2000): 6,185 People

Current Use Rate: 450 GPCD

County Average: 248 GPCD

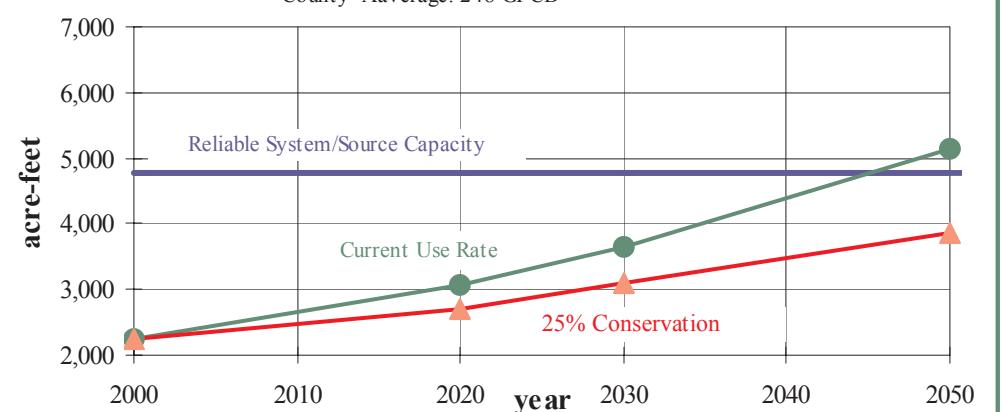


Lewiston




acre-feet/year




Population Served (2000): 1,736 People




Current Use Rate: 311 GPCD

County Use Rate: 248 GPCD

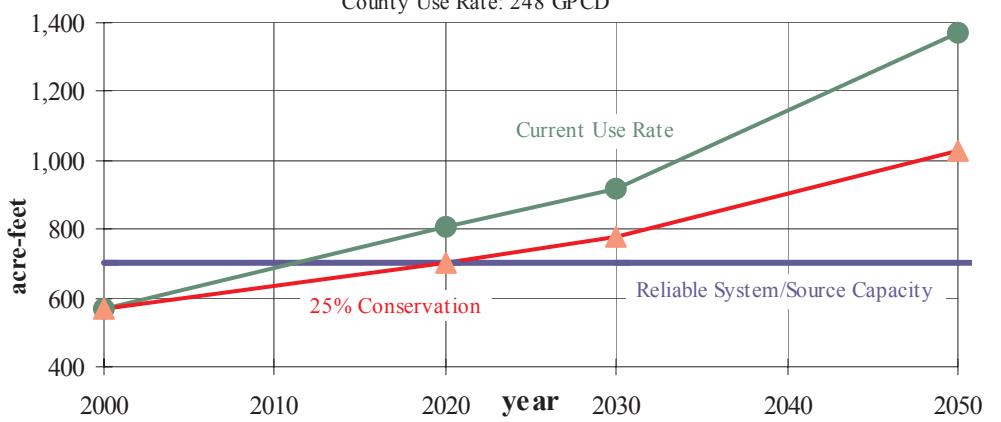

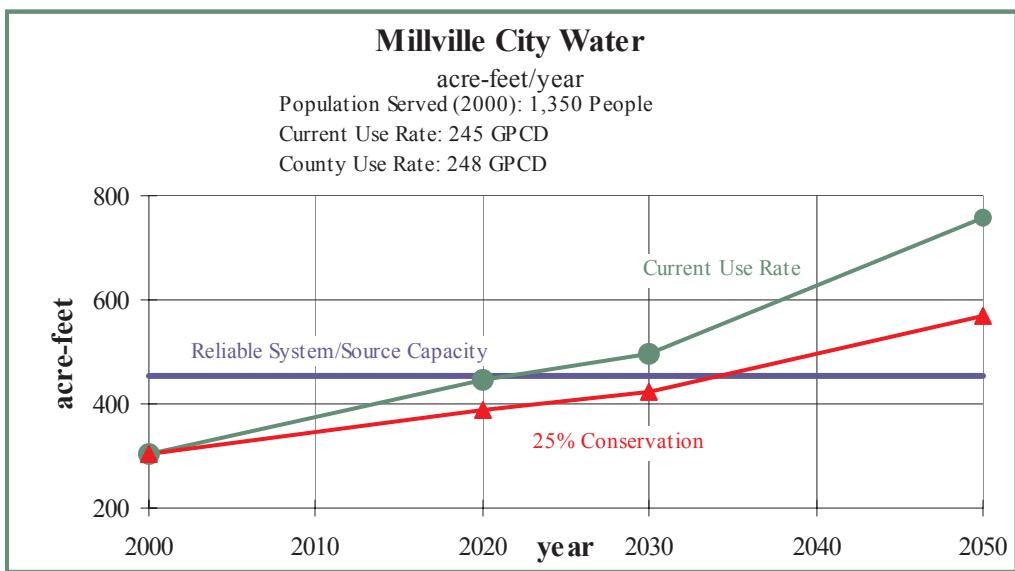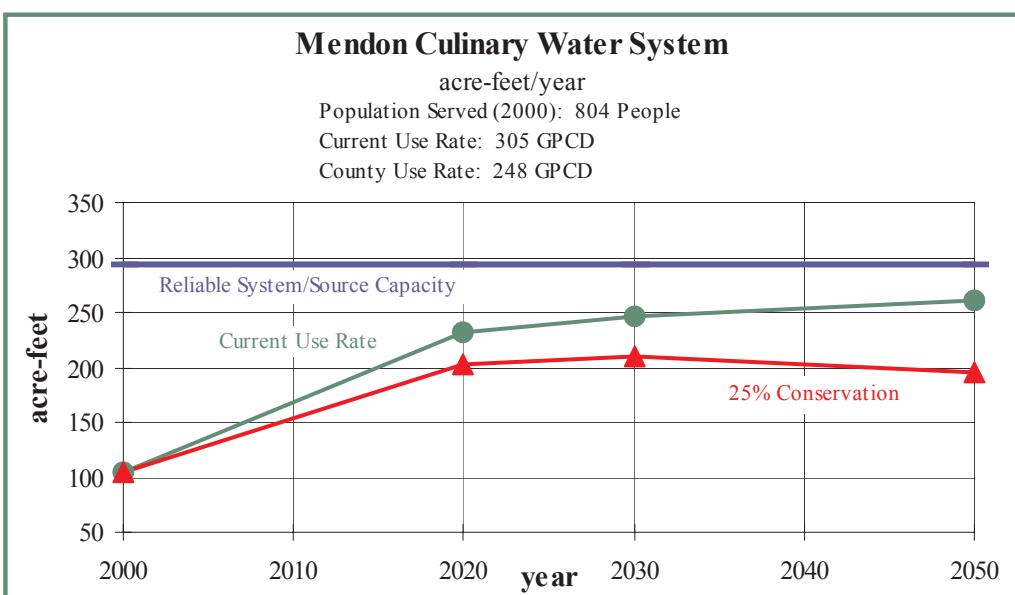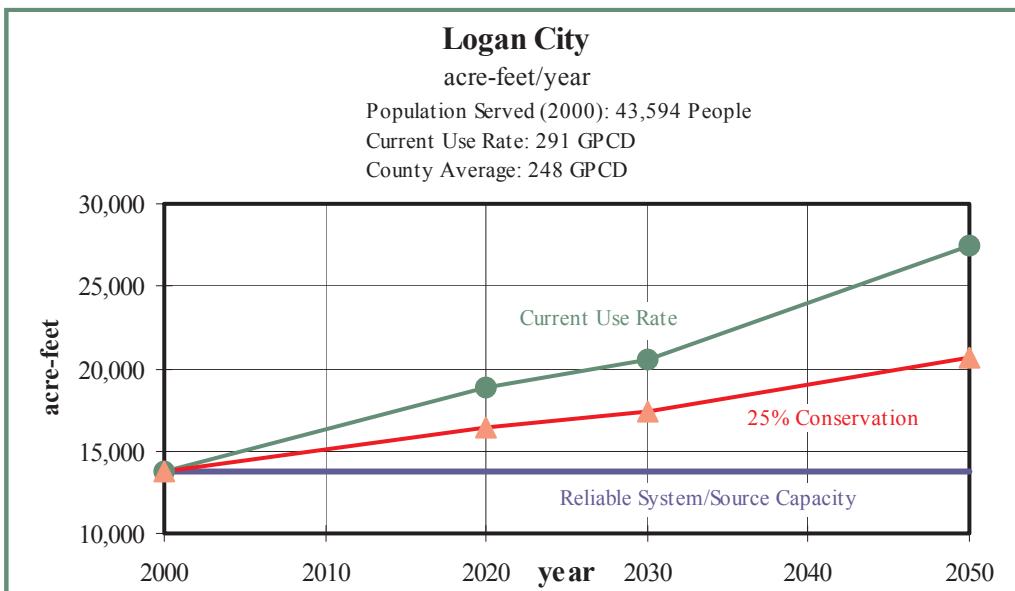

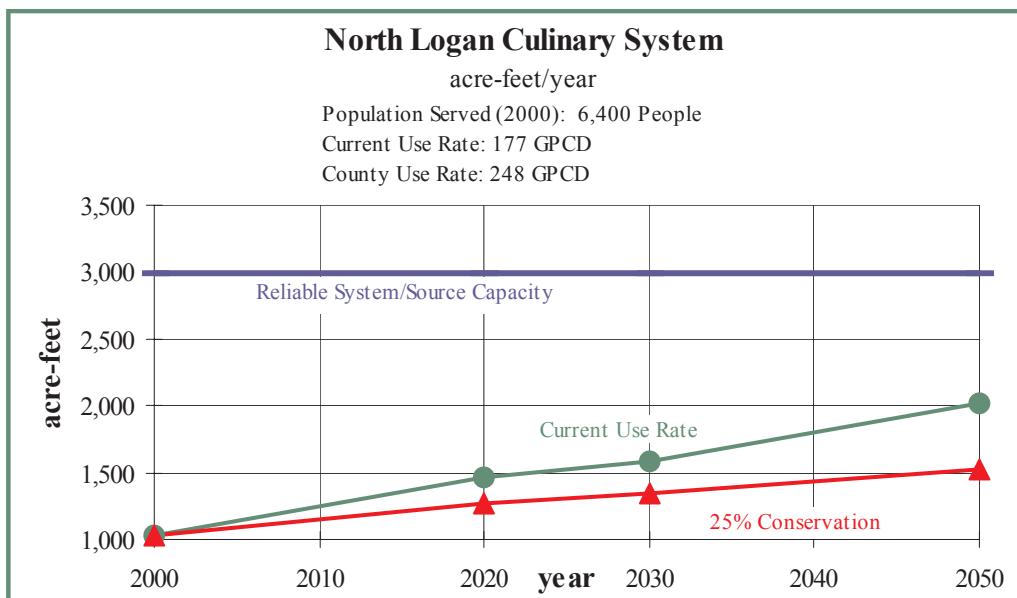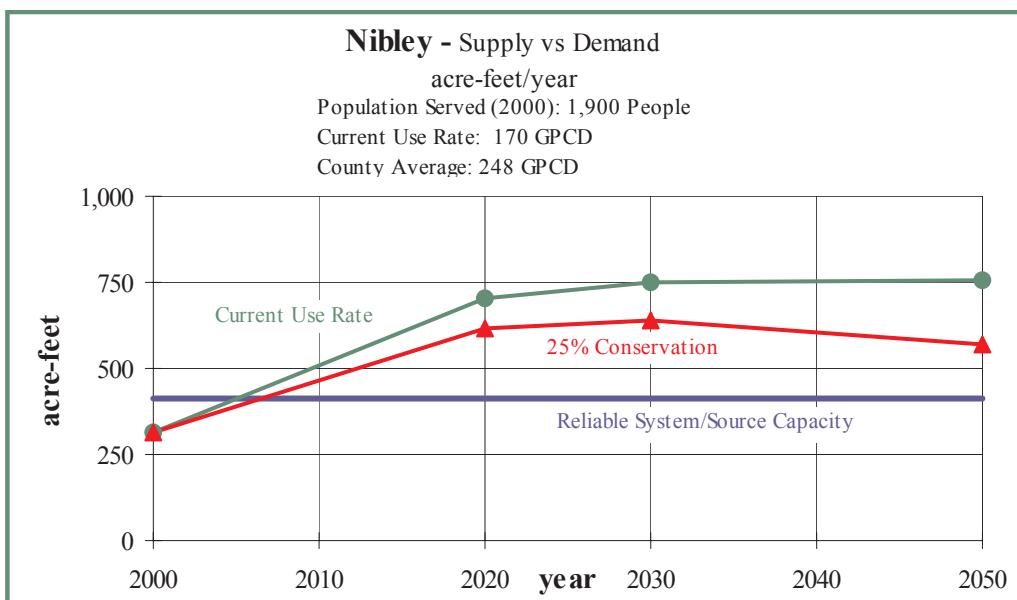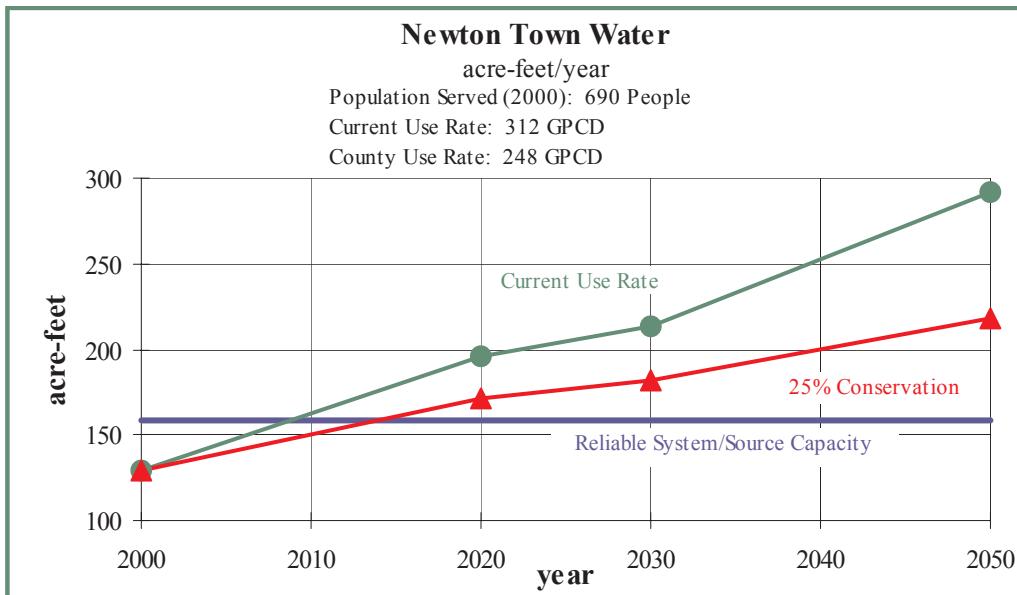

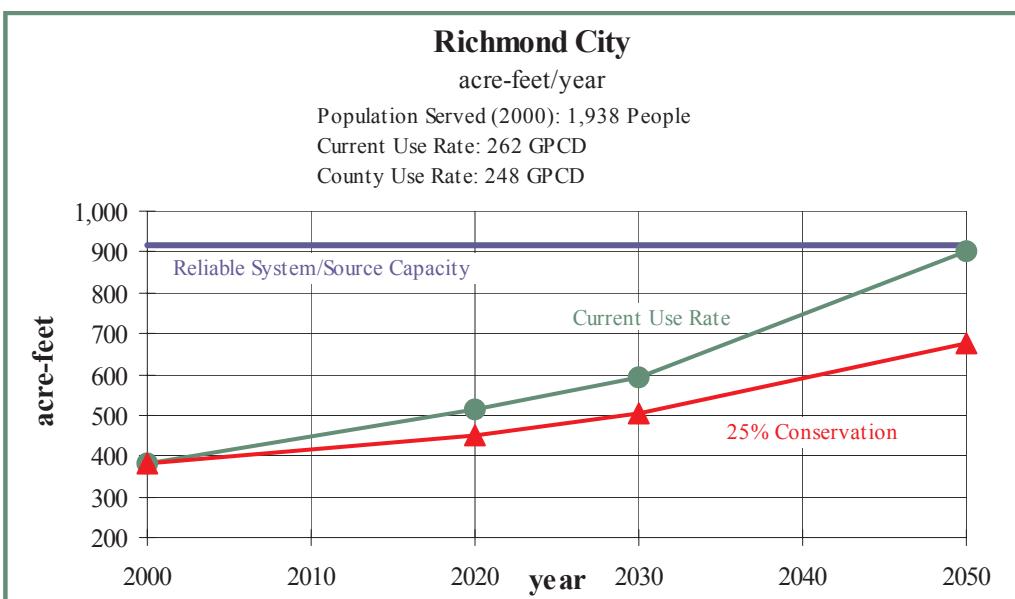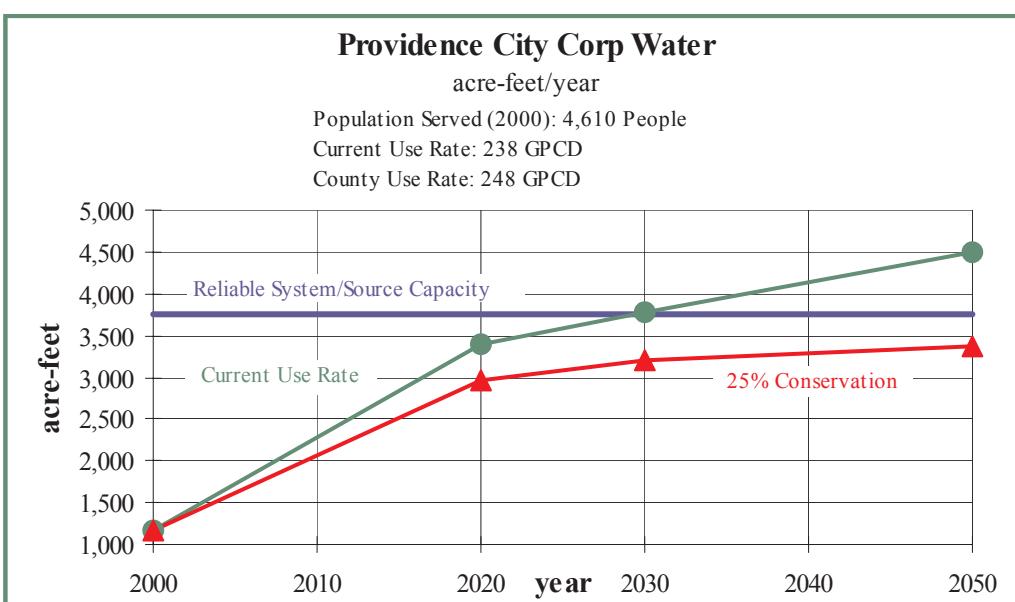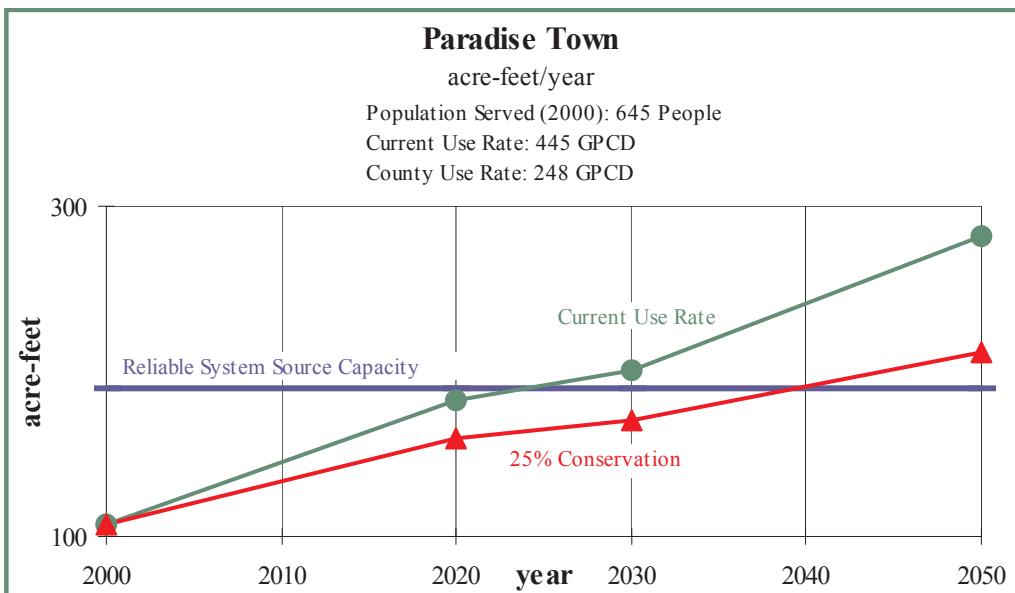


River Heights City Water System

acre-feet/year

Population Served (2000): 1,480 People

Current Use Rate: 359 GPCD

County Use Rate: 248 GPCD

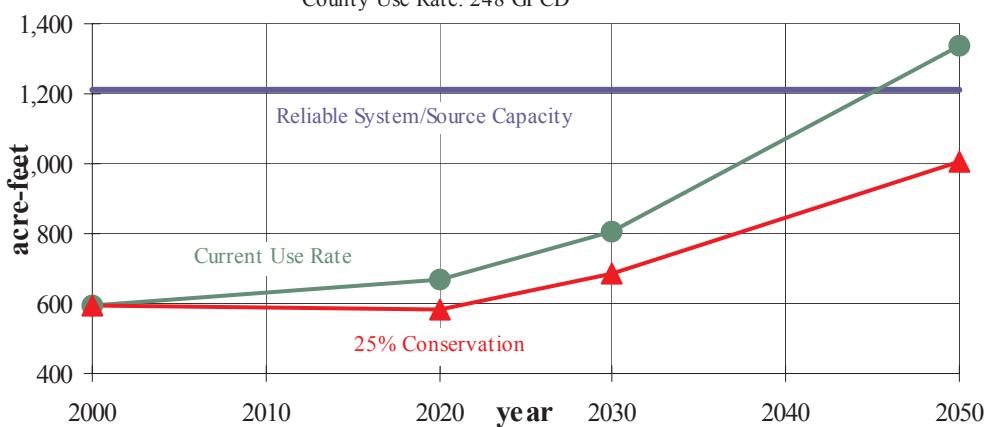


Smithfield Municipal Water System

acre-feet/year

Population Served (2000): 7,420 People

Current Use Rate: 230 GPCD

County Use Rate: 248 GPCD

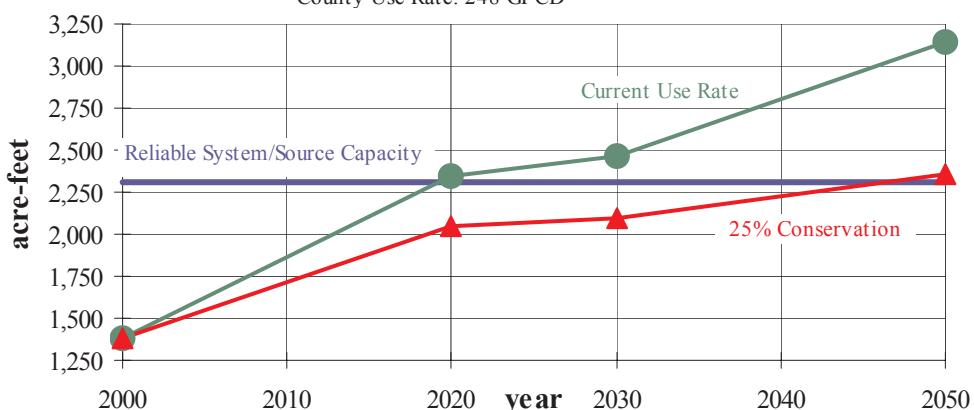


Trenton City


acre-feet/year

Population Served (2000): 500 People


Current Use Rate: 279 GPCD

County Use Rate: 248 GPCD

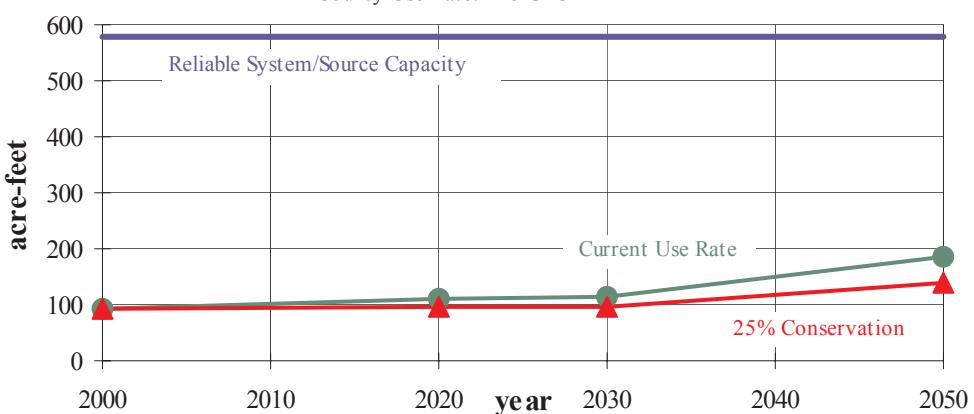

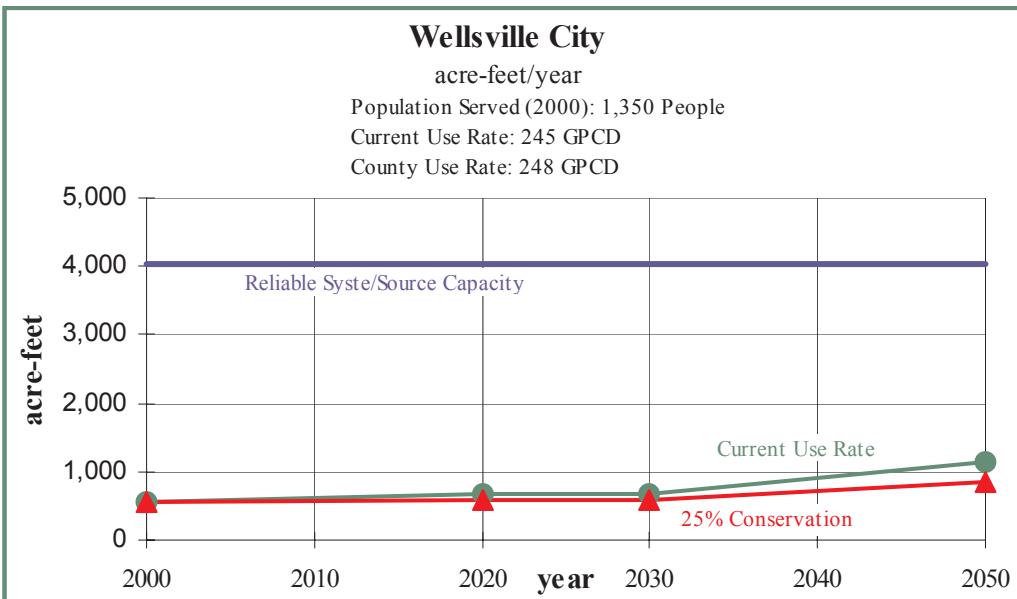

Rich County Communities:

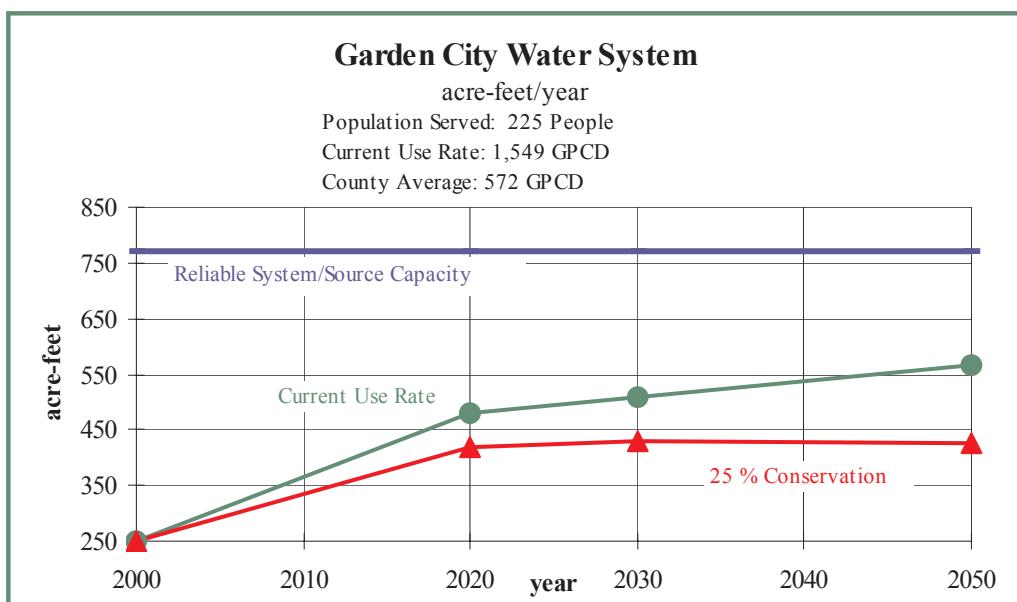


Laketown City Water System

acre-feet/year

Population Served (2000): 340 People

Current Use Rate: 672 GPCD

County Average: 572 GPCD

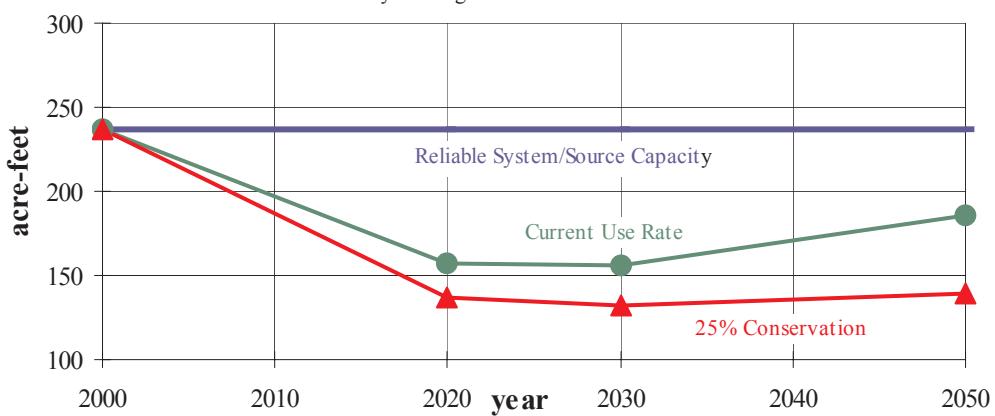


Randolph City

acre-feet/year

Population Served (2000): 500 People

Current Use Rate: 525 GPCD

County Use Rate: 572 GPCD

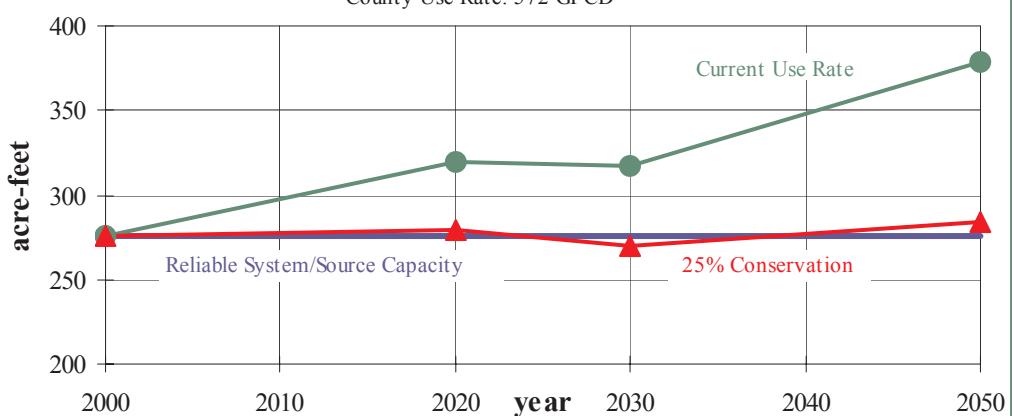

Woodruff Culinary Water System

acre-feet/year

Population Served (2000): 194 People

Current Use Rate: 239 GPCD

County Use Rate: 249 GPCD

